

Local Development Plan Provisions

1.0 GENERAL PROVISIONS

- 1.1 The provisions outlined in this Local Development Plan (LDP) constitute variations to the requirements of the City of Rockingham Local Planning Scheme No.2 (LPS2), State Planning Policy 7.3 - Residential Design Codes Volume 1 (R-Codes) and Planning Policy (PP) 3.3.22 – Medium-Density Single Housing Development Standards – Development Zones. The requirements of LPS2, including PP 3.3.22 and any other PPs, and the R-Codes must be satisfied in all other matters.

- 1.2 The density code for each lot is in accordance with the approved The Rivergums Local Structure Plan.

2.0 NOISE

- 2.1 In accordance with the approved Transportation Noise Assessment (TNA) 16 September 2022, lots affected by transport noise levels are to implement quiet house packages for ground floor development as shown on this LDP. Requirements for first floor development are detailed in the approved TNA.

- 2.2 As provided for in the approved TNA, alternative construction methods to the deemed to satisfy packages may be acceptable if supported by a report undertaken by a suitably qualified acoustical consultant.






3.0 BUSHFIRE

- 3.1 In accordance with the approved Bushfire Management Plan (BMP) 9 September 2022, lots affected by BAL-40/Flame Zone are subject to a Habitable Building Exclusion Zone as shown on this LDP. The Habitable Building Exclusion Zone is determined by a setback from the rear boundary of the lot. Setback requirements for the affected lots are detailed in Table 1 and the approved BMP.


Table 1 Habitable Building Exclusion Zone

Lots	Rear Lot Boundary Setback
Lots 2446 – 2457	5.0m
Lot 2460	5.5m
Lot 2459	7.0m
Lots 2458 & 2461 – 2462	6.0m

Legend

-  Extent of Local Development Plan
 RMD-25
 RMD-40
 Lots subject to Quiet House Design Requirements - Package A (Ground Floor)
 Lots subject to Quiet House Design Requirements - Package B (Ground Floor)
 Lots subject to Bushfire Planning Requirements - Refer to Approved Bushfire Management Plan - 24 July 2017 (as amended)
 Habitable Building Exclusion Zone in accordance with Bushfire Management Plan (in accordance with Table 1)
 Acoustic Wall

Location Plan

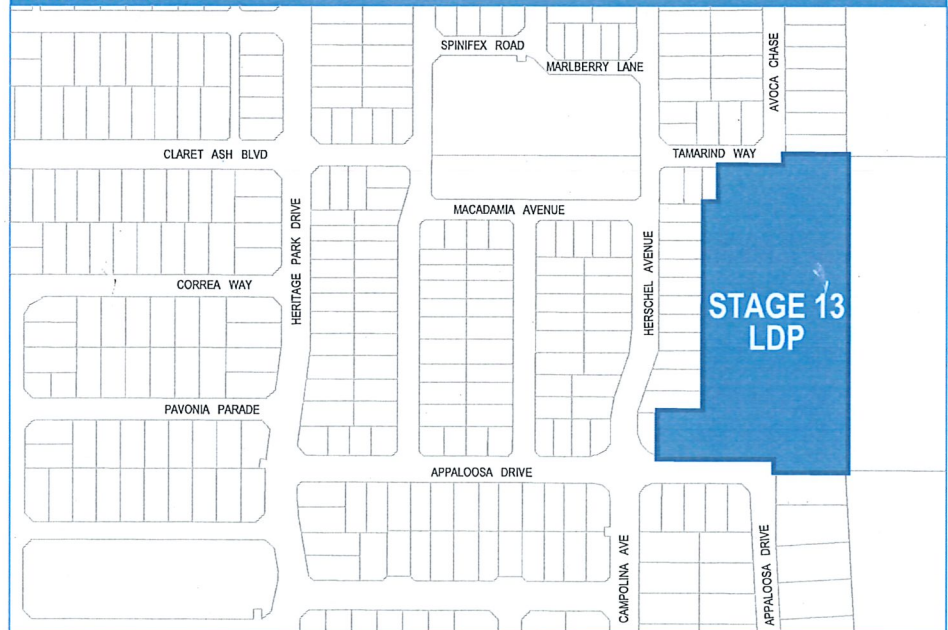

Endorsement Table

This Local Development Plan has been approved by Council under the provisions of the City of Rockingham Local Planning Scheme No. 2

Manager Statutory Planning

Date 1/2/2023



Local Development Plan

scale:
1:1000@A3 | 1:500@A1

plan:
15/029/035C

Taylor Burrell Barnett Town Planning & Design
Level 7, 160 St Georges Terrace, Perth WA 6000
e: admin@tbbplanning.com.au
p: (08) 9226 4276



Quiet House Package A

Element	Orientation	Room	
		Bedroom	Indoor Living and Work Areas
External Windows	Facing	<ul style="list-style-type: none"> Up to 40% floor area ($R_w + C_{tr} \geq 28$): <ul style="list-style-type: none"> Sliding or double hung with minimum 10mm single or 6mm-12mm-10mm double insulated glazing; Sealed awning or casement windows with minimum 6mm glass. Up to 60% floor area ($R_w + C_{tr} \geq 31$): <ul style="list-style-type: none"> Sealed awning or casement windows with minimum 6mm glass. 	<ul style="list-style-type: none"> Up to 40% floor area ($R_w + C_{tr} \geq 25$): <ul style="list-style-type: none"> Sliding or double hung with minimum 6mm single or 6mm-12mm-6mm double insulated glazing; Up to 60% floor area ($R_w + C_{tr} \geq 28$); Up to 80% floor area ($R_w + C_{tr} \geq 31$).
	Side On	As above, except $R_w + C_{tr}$ values may be 3 dB less or max % area increased by 20%.	
	Opposite	No specific requirements	
External Doors	Facing	<ul style="list-style-type: none"> Fully glazed hinged door with certified $R_w + C_{tr} \geq 28$ rated door and frame including seals and 6mm glass. 	<ul style="list-style-type: none"> Doors to achieve $R_w + C_{tr} \geq 25$: <ul style="list-style-type: none"> 35mm Solid timber core hinged door and frame system certified to R_w 28 including seals; Glazed sliding door with 10mm glass and weather seals.
	Side On	As above, except $R_w + C_{tr}$ values may be 3 dB less.	
	Opposite	No specific requirements	
External Walls	All	<ul style="list-style-type: none"> $R_w + C_{tr} \geq 45$: <ul style="list-style-type: none"> Two leaves of 90mm thick clay brick masonry with minimum 20mm cavity; or Single leaf of 150mm brick masonry with 13mm cement render on each face; or One row of 92mm studs at 600mm centres with: <ul style="list-style-type: none"> Resilient steel channels fixed to the outside of the studs; and 9.5mm hardboard or fibre cement sheeting or 11mm fibre cement weatherboards fixed to the outside; 75mm thick mineral wool insulation with a density of at least 11kgkg/m³; and 2 x 16mm fire-rated plasterboard to inside. 	
Roofs and Ceilings	All	<ul style="list-style-type: none"> $R_w + C_{tr} \geq 35$: <ul style="list-style-type: none"> Concrete or terracotta tile or metal sheet roof with sarking and at least 10mm plasterboard. 	
Outdoor Living Areas		At least one outdoor living area located on the opposite side of the building from the transport corridor and/or at least one ground level outdoor living area screened using a solid continuous fence or other structure of minimum 2 metres height above ground level.	

Quiet House Package B

Element	Orientation	Room	
		Bedroom	Indoor Living and Work Areas
External Windows	Facing	<ul style="list-style-type: none"> Up to 40% floor area ($R_w + C_{tr} \geq 31$): <ul style="list-style-type: none"> Fixed sash, awning or casement with minimum 6mm glass or 6mm-12mm-6mm double insulated glazing. Up to 60% floor area ($R_w + C_{tr} \geq 34$): <ul style="list-style-type: none"> Fixed sash, awning or casement with minimum 10mm glass or 6mm-12mm-10mm double insulated glazing. 	<ul style="list-style-type: none"> Up to 40% floor area ($R_w + C_{tr} \geq 28$): <ul style="list-style-type: none"> Sliding or double hung with 6mm-12mm-10mm double insulated glazing; Sealed awning or casement windows with minimum 6mm glass. Up to 60% floor area ($R_w + C_{tr} \geq 31$); Up to 80% floor area ($R_w + C_{tr} \geq 34$).
	Side On	As above, except $R_w + C_{tr}$ values may be 3 dB less or max % area increased by 20%.	
	Opposite	As above, except $R_w + C_{tr}$ values may be 6 dB less or max % area increased by 20%.	
External Doors	Facing	<ul style="list-style-type: none"> Fully glazed hinged door with certified $R_w + C_{tr} \geq 31$ rated door and frame including seals and 10mm glass. 	<ul style="list-style-type: none"> Doors to achieve $R_w + C_{tr} \geq 28$: <ul style="list-style-type: none"> 40mm Solid timber core hinged door and frame system certified to $R_w 32$ including seals; Fully glazed hinged door with certified $R_w + C_{tr} \geq 28$ rated door and frame including seals and 6mm glass.
	Side On	As above, except $R_w + C_{tr}$ values may be 3 dB less or max % area increased by 20%.	
	Opposite	As above, except $R_w + C_{tr}$ values may be 6 dB less or max % area increased by 20%.	
External Walls	All	<ul style="list-style-type: none"> $R_w + C_{tr} \geq 50$: <ul style="list-style-type: none"> Two leaves of 90mm thick clay brick masonry with minimum 50mm cavity between leaves and 25mm glasswool or polyester (24kg/m³). Resilient ties used where required to connect leaves. Two leaves of 110mm clay brick masonry with minimum 50mm cavity between leaves and 25mm glasswool or polyester insulation (24kg/m³). Single leaf of 220mm brick masonry with 13mm cement render on each face. 150mm thick unlined concrete panel or 200mm thick concrete panel with one layer of 13mm plasterboard or 13mm cement render on each face. Single leaf of 90mm clay brick masonry with: <ul style="list-style-type: none"> A row of 70mm x 35mm timber studs or 64mm steel studs at 600mm centres; A cavity of 25mm between leaves; 50mm glasswool or polyester insulation (11kg/m³) between studs; and One layer of 10mm plasterboard fixed to the inside face. 	
Roofs and Ceilings	All	<ul style="list-style-type: none"> $R_w + C_{tr} \geq 35$: <ul style="list-style-type: none"> Concrete or terracotta tile or metal sheet roof with sarking and at least 10mm plasterboard ceiling with R3.0+ fibrous insulation. 	
Outdoor Living Areas		At least one outdoor living area located on the opposite side of the building from the transport corridor and/or at least one ground level outdoor living area screened using a solid continuous fence or other structure of minimum 2.4 metres height above ground level.	

Quiet House Package C

Element	Orientation	Room	
		Bedroom	Indoor Living and Work Areas
External Windows	Facing	<ul style="list-style-type: none"> Up to 20% floor area ($R_w + C_{tr} \geq 31$): <ul style="list-style-type: none"> Fixed sash, awning or casement with minimum 6mm glass or 6mm-12mm-6mm double insulated glazing. Up to 40% floor area ($R_w + C_{tr} \geq 34$): <ul style="list-style-type: none"> Fixed sash, awning or casement with minimum 10mm glass or 6mm-12mm-10mm double insulated glazing. 	<ul style="list-style-type: none"> Up to 40% floor area ($R_w + C_{tr} \geq 31$): <ul style="list-style-type: none"> Fixed sash, awning or casement with minimum 6mm glass or 6mm-12mm-6mm double insulated glazing. Up to 60% floor area ($R_w + C_{tr} \geq 34$): <ul style="list-style-type: none"> Fixed sash, awning or casement with minimum 10mm glass or 6mm-12mm-10mm double insulated glazing.
	Side On	As above, except $R_w + C_{tr}$ values may be 3 dB less or max % area increased by 20%.	
	Opposite	As above, except $R_w + C_{tr}$ values may be 6 dB less or max % area increased by 20%.	
External Doors	Facing	<ul style="list-style-type: none"> Not recommended. 	<ul style="list-style-type: none"> Doors to achieve $R_w + C_{tr} \geq 30$: <ul style="list-style-type: none"> Fully glazed hinged door with certified $R_w + C_{tr} \geq 31$ rated door and frame including seals and 10mm glass; 40mm Solid timber core side hinged door, frame and seal system certified to $R_w 32$ including seals. Any glass inserts to be minimum 6mm.
	Side On	As above, except $R_w + C_{tr}$ values may be 3 dB less or max % area increased by 20%.	
	Opposite	As above, except $R_w + C_{tr}$ values may be 6 dB less or max % area increased by 20%.	
External Walls	All	<ul style="list-style-type: none"> $R_w + C_{tr} \geq 50$: <ul style="list-style-type: none"> Two leaves of 90mm thick clay brick masonry with minimum 50mm cavity between leaves and 25mm glasswool or polyester insulation (24kg/m³). Resilient ties used where required to connect leaves. Two leaves of 110mm clay brick masonry with minimum 50mm cavity between leaves and 25mm glasswool or polyester insulation (24kg/m³). Single leaf of 220mm brick masonry with 13mm cement render on each face. 150mm thick unlined concrete panel or 200mm thick concrete panel with one layer of 13mm plasterboard or 13mm cement render on each face. Single leaf of 90mm clay brick masonry with: <ul style="list-style-type: none"> A row of 70mm x 35mm timber studs or 64mm steel studs at 600mm centres; A cavity of 25mm between leaves; 50mm glasswool or polyester insulation (11kg/m³) between studs; and One layer of 10mm plasterboard fixed to the inside face. 	
Roofs and Ceilings	All	<ul style="list-style-type: none"> $R_w + C_{tr} \geq 40$: <ul style="list-style-type: none"> Concrete or terracotta tile roof with sarking, or metal sheet roof with foil backed R2.0+ fibrous insulation between steel sheeting and roof battens; R3.0+ insulation batts above ceiling; 2 x 10mm plasterboard ceiling or 1 x 13mm sound-rated plasterboard affixed using steel furring channel to ceiling rafters. 	
Outdoor Living Areas		At least one outdoor living area located on the opposite side of the building from the transport corridor and/or at least one ground level outdoor living area screened using a solid continuous fence or other structure of minimum 2.4 metres height above ground level.	